


# LEDALITE - TRUGROOVE SUSPENDED

**TEST DATE:** 04 May 2021 **CATALOG NO:** 29x6L95035LQ


<b>Lamp Type:</b>	LED	<b>Description:</b>	SILK 60%DN 3500LM 950
<b>No. of Lamps:</b>	176		
<b>Rated Lamp Lumens:</b>	-1	<b>Flux (lm), Efficiency (%):</b>	3784 lm 100%
<b>Input Watts:</b>	277 VAC 33.0	<b>Up/Dn Ratio, Efficacy (lm/W):</b>	62% Down / 38% Up 114.7
<b>CIE-IES Classification:</b>	Semi-Direct	<b>Report:</b>	LNG01297

CANDELA DISTRIBUTION						
	Flux					
	0	22.5	45	67.5	90	Lumens
0	852	852	852	852	852	
5	847	848	847	849	847	81
15	811	815	810	814	806	229
25	745	751	740	745	735	343
35	656	663	649	653	639	408
45	547	554	540	543	534	419
55	421	430	417	420	401	374
65	290	299	283	286	275	283
75	147	157	146	149	143	158
85	33	37	34	36	32	41
90	0	0	0	0	0	
95	6	8	8	9	10	11
105	23	30	100	427	565	199
115	61	90	271	534	693	316
125	163	193	292	459	539	289
135	191	215	285	396	444	235
145	202	225	281	351	381	180
155	215	232	265	300	314	123
165	228	238	251	264	267	71
175	236	240	242	245	245	23
180	240	240	240	240	240	

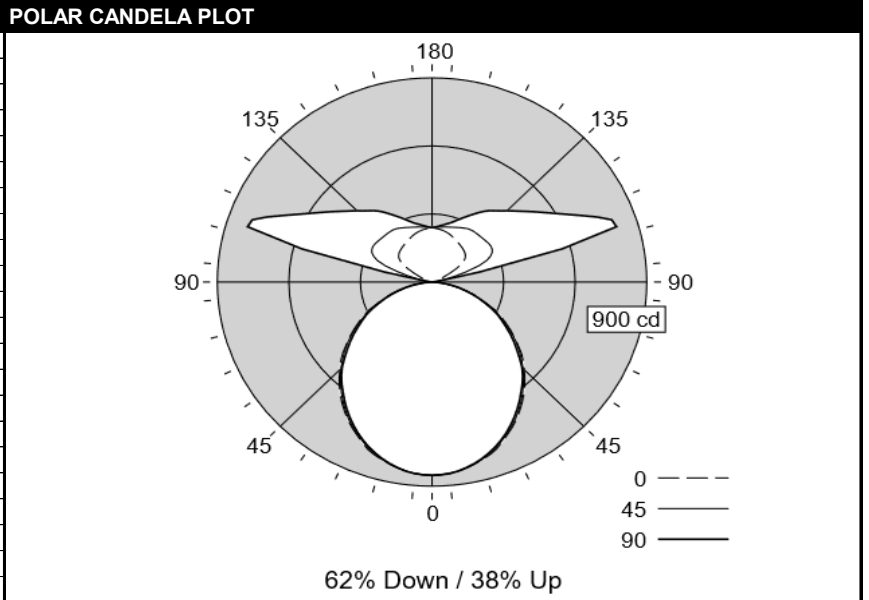

CHARACTERISTICS					COEFFICIENTS OF UTILIZATION (%)											
RP1	Meets RP-1-12 recommendations for VDT-Normal spaces				Pc---	80										
Direct: Peak Candela & Angle (0°)	852.3	0.0	Pw---	70	50	30	10	70	50	30	50	30	10	0		
Direct: Peak Candela & Angle (90°)	852.3	0.0	RCR	0	110	110	110	110	103	103	103	90	90	90	62	
Spacing Criteria (0°, 90°, 180°)	1.23	1.21	N/A	1	100	96	92	88	94	90	86	79	76	74	52	
Beam (H, V), Field (H, V)	106.1	109.2	160.4	160.9	2	91	84	77	72	85	78	73	69	65	61	43
Indirect: Peak Candela & Angle(°)	810.7	107.5	3	83	73	66	60	78	69	62	61	55	51	36		
Indirect: Zenith Candela, Peak to Zenith	240.3	3.37	4	76	65	57	50	71	61	54	54	48	43	31		
Luminous Width, Length, Height (ft)	0.25	4.00	0.00	5	70	58	49	43	65	54	47	48	42	37	27	
DLC, UGR (4H x 8H, 1.0H), MDER	N/A	20.5	0.809	6	64	52	44	38	60	49	41	43	37	33	24	
x, y, CCT, D <sub>uv</sub>	0.3420	0.3512	5121	0.0011	7	59	47	39	33	56	44	37	39	33	29	21
CRI (R <sub>a</sub> ), R <sub>g</sub> , G <sub>a</sub> , C <sub>g</sub>	93	68	99	94	8	55	43	35	29	52	40	33	36	30	26	19
TM-30-18 R <sub>f</sub> , R <sub>g</sub> , R <sub>h1</sub> , R <sub>g</sub> , R <sub>sb,h1</sub>	90	89	100	-5%	9	51	39	31	26	48	37	30	33	27	23	17
120V: P(W), I(A), THD(%), PF	32.3	0.272	12.8	0.988	10	48	36	28	23	45	34	27	30	25	21	15
277V: P(W), I(A), THD(%), PF	33.0	0.129	17.4	0.925	*Based on a floor reflectance of 0.2											
347V: P(W), I(A), THD(%), PF	32.2	0.099	11.0	0.940												

ZONAL LUMENS (lm)			
Zone	Lumens	%Fixture	%Lamp
0-30	653	17.2%	17.2%
0-40	1061	28.0%	28.0%
0-60	1854	49.0%	49.0%
0-90	2336	61.7%	61.7%
90-130	815	21.5%	21.5%
90-150	1231	32.5%	32.5%
90-180	1448	38.3%	38.3%
0-180	3784	100.0%	100.0%






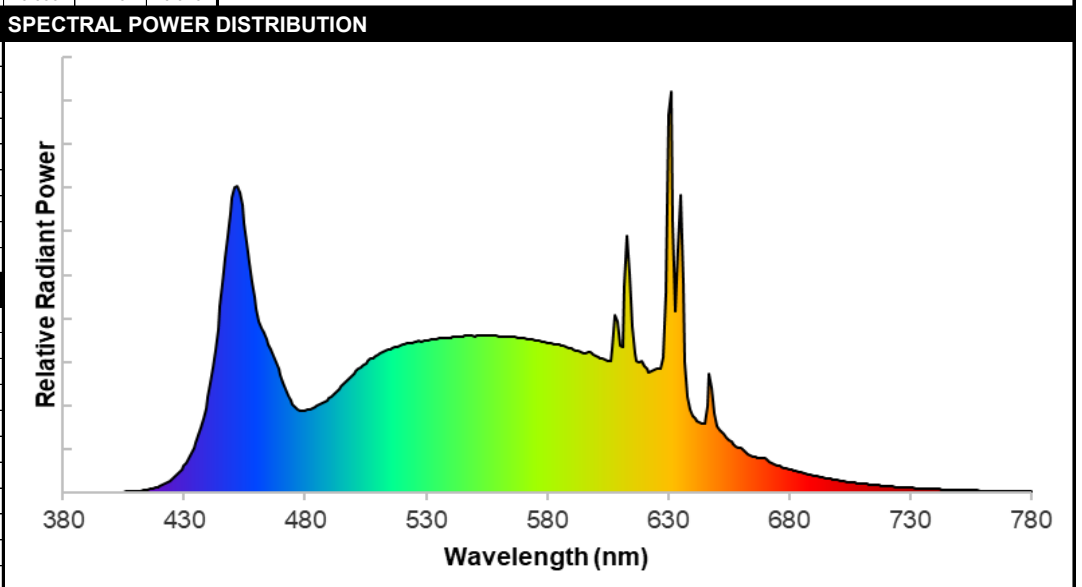


AVG LUMINANCE (cd/m <sup>2</sup> )			
	0	45	90
0	9171	9171	9171
5	9153	9146	9152
15	9034	9020	8982
25	8839	8790	8721
35	8620	8524	8396
45	8327	8213	8118
55	7896	7819	7517
65	7391	7193	6994
75	6120	6049	5962
85	4086	4161	3951

# Output of GLA Calculation Tool for CIE 13.3 CRI and Associated CRI-based Colour Rendition Properties

<b>Test Number:</b>	T20201109	<b>Manufacturer:</b>	Ledalite by Signify
<b>Date:</b>	27 Aug 2020	<b>Model:</b>	TruGroove Suspended

<b>Correlated Colour Temperature (<math>T_{cp}</math>) in K</b>	5121	<b>CIE1931 chromaticity coordinate, <math>x</math></b>	0.3420
<b>Distance to Blackbody Locus (<math>D_{uv}</math>)</b>	0.0011	<b>CIE1931 chromaticity coordinate, <math>y</math></b>	0.3512
<b>General Colour Rendering Index (<math>R_a</math>)</b>	93	<b>CIE1976 chromaticity coordinate, <math>u'</math></b>	0.2095
<b>Red Rendering Index (<math>R_9</math>)</b>	68	<b>CIE1976 chromaticity coordinate, <math>v'</math></b>	0.4840
<b>Colour Gamut Index (<math>G_a</math>)</b>	99		
<b>Red Chroma Index (<math>C_9</math>)</b>	94		

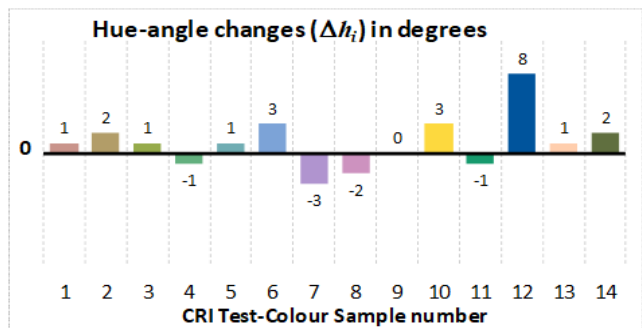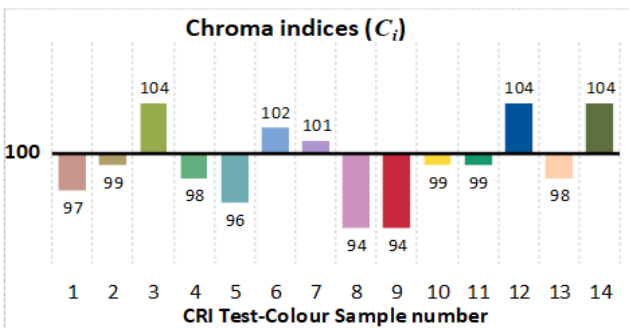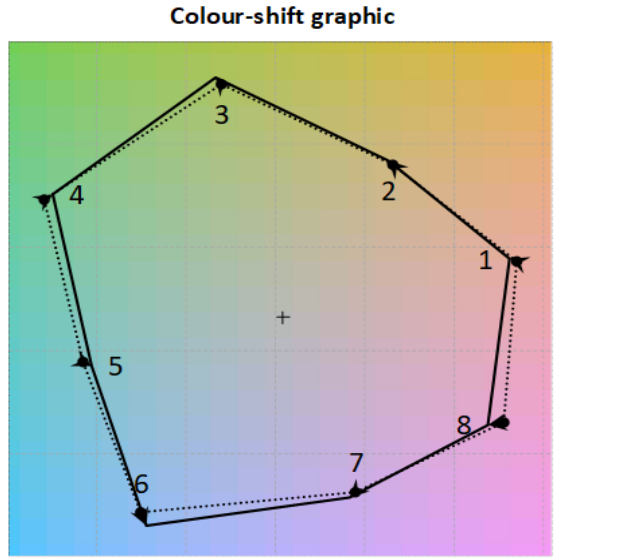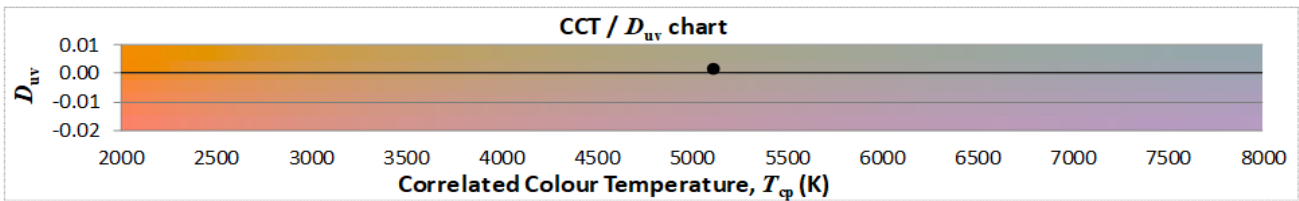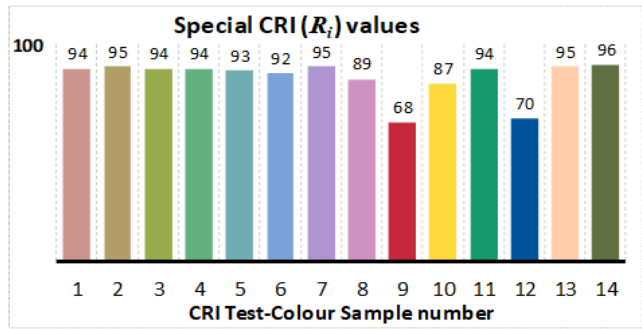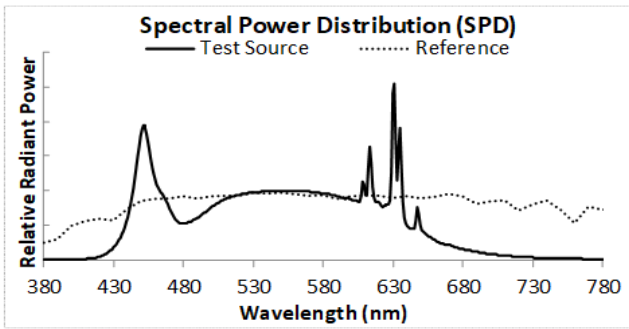







# ANSI/IES TM-30-18 Color Rendition Report

Source: T20201109

Manufacturer: Ledalite by Signify

Date: 27 Aug 2020

Model: TruGroove Suspended

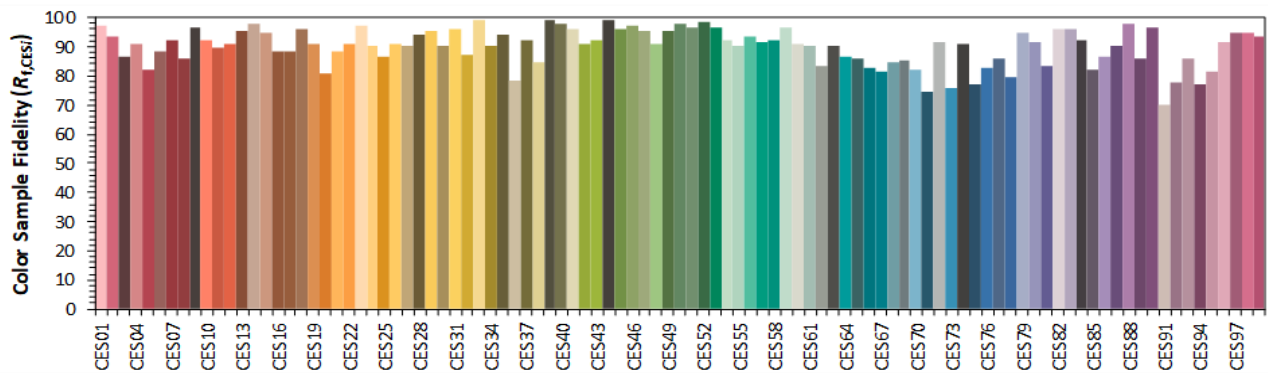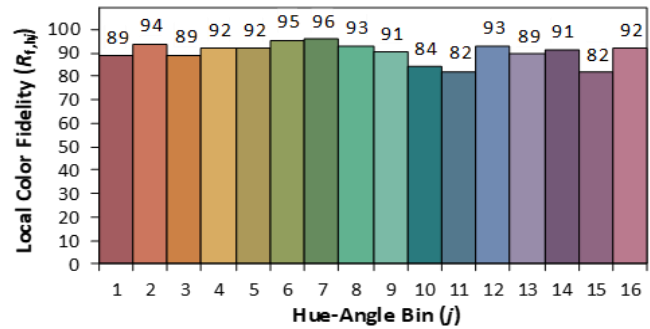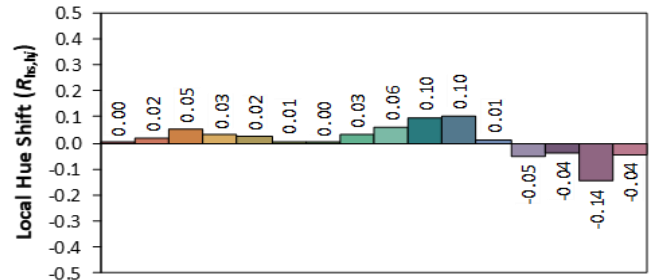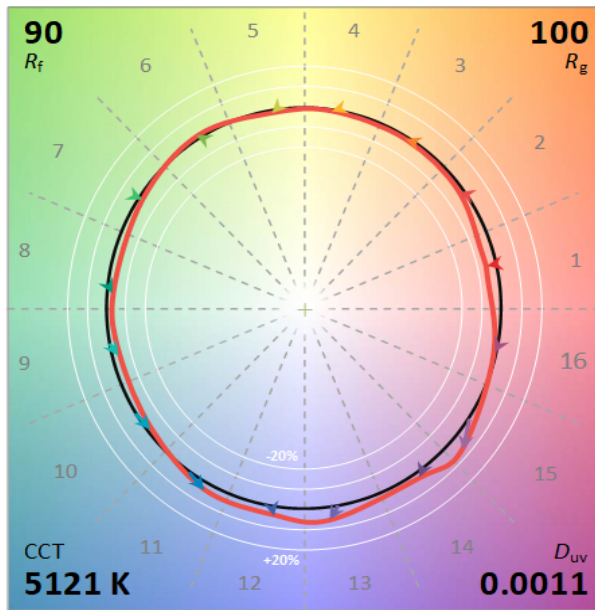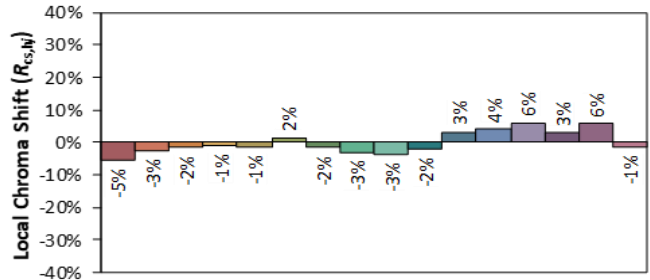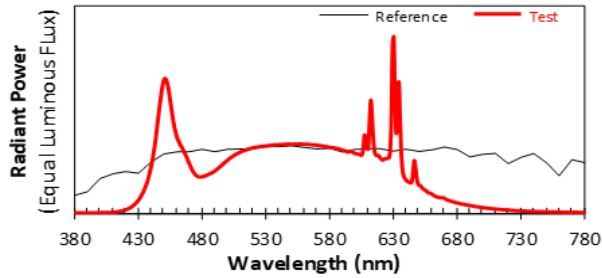

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.3420

y 0.3512

u' 0.2095

v' 0.4840

### SPECTRAL POWER DISTRIBUTION

λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD	λ (nm)	SPD
380	0.00010	425	0.00600	470	0.05370	515	0.06580	560	0.07190	605	0.06060	650	0.03040	695	0.00680	740	0.00160
381	0.00020	426	0.00690	471	0.05050	516	0.06650	561	0.07180	606	0.06070	651	0.02900	696	0.00680	741	0.00160
382	0.00020	427	0.00800	472	0.04730	517	0.06670	562	0.07180	607	0.06610	652	0.02840	697	0.00630	742	0.00150
383	0.00020	428	0.00920	473	0.04480	518	0.06700	563	0.07170	608	0.08130	653	0.02680	698	0.00620	743	0.00150
384	0.00020	429	0.01060	474	0.04250	519	0.06750	564	0.07170	609	0.07850	654	0.02520	699	0.00600	744	0.00140
385	0.00020	430	0.01210	475	0.04070	520	0.06790	565	0.07150	610	0.06720	655	0.02420	700	0.00580	745	0.00140
386	0.00020	431	0.01380	476	0.03920	521	0.06820	566	0.07130	611	0.06690	656	0.02360	701	0.00560	746	0.00140
387	0.00030	432	0.01580	477	0.03830	522	0.06850	567	0.07130	612	0.09480	657	0.02240	702	0.00540	747	0.00130
388	0.00020	433	0.01800	478	0.03770	523	0.06850	568	0.07120	613	0.11790	658	0.02130	703	0.00520	748	0.00130
389	0.00010	434	0.02040	479	0.03750	524	0.06880	569	0.07110	614	0.10040	659	0.02080	704	0.00500	749	0.00120
390	0.00020	435	0.02320	480	0.03760	525	0.06920	570	0.07110	615	0.07640	660	0.02040	705	0.00490	750	0.00120
391	0.00010	436	0.02640	481	0.03790	526	0.06940	571	0.07070	616	0.06420	661	0.01960	706	0.00480	751	0.00120
392	0.00010	437	0.02980	482	0.03830	527	0.06960	572	0.07060	617	0.06040	662	0.01860	707	0.00460	752	0.00110
393	0.00020	438	0.03390	483	0.03870	528	0.06950	573	0.07050	618	0.05990	663	0.01780	708	0.00440	753	0.00110
394	0.00020	439	0.03870	484	0.03930	529	0.06990	574	0.07030	619	0.06020	664	0.01730	709	0.00430	754	0.00110
395	0.00020	440	0.04390	485	0.04000	530	0.06990	575	0.06990	620	0.05820	665	0.01680	710	0.00420	755	0.00100
396	0.00020	441	0.05030	486	0.04030	531	0.07000	576	0.06970	621	0.05670	666	0.01640	711	0.00410	756	0.00100
397	0.00020	442	0.05730	487	0.04110	532	0.07020	577	0.06970	622	0.05520	667	0.01600	712	0.00390	757	0.00100
398	0.00020	443	0.06570	488	0.04170	533	0.07060	578	0.06920	623	0.05580	668	0.01570	713	0.00380	758	0.00100
399	0.00020	444	0.07490	489	0.04240	534	0.07050	579	0.06910	624	0.05660	669	0.01590	714	0.00370	759	0.00090
400	0.00020	445	0.08550	490	0.04330	535	0.07080	580	0.06880	625	0.05690	670	0.01580	715	0.00350	760	0.00090
401	0.00030	446	0.09650	491	0.04410	536	0.07090	581	0.06860	626	0.05720	671	0.01500	716	0.00350	761	0.00080
402	0.00030	447	0.10810	492	0.04530	537	0.07100	582	0.06840	627	0.05720	672	0.01420	717	0.00330	762	0.00080
403	0.00030	448	0.11820	493	0.04630	538	0.07100	583	0.06820	628	0.06190	673	0.01370	718	0.00320	763	0.00080
404	0.00030	449	0.12840	494	0.04730	539	0.07100	584	0.06820	629	0.09160	674	0.01320	719	0.00310	764	0.00080
405	0.00040	450	0.13540	495	0.04860	540	0.07120	585	0.06780	630	0.17380	675	0.01270	720	0.00300	765	0.00080
406	0.00040	451	0.14010	496	0.04980	541	0.07140	586	0.06770	631	0.18410	676	0.01230	721	0.00290	766	0.00080
407	0.00040	452	0.14060	497	0.05100	542	0.07160	587	0.06750	632	0.12410	677	0.01190	722	0.00290	767	0.00070
408	0.00050	453	0.13770	498	0.05210	543	0.07170	588	0.06700	633	0.08320	678	0.01150	723	0.00280	768	0.00070
409	0.00060	454	0.13200	499	0.05350	544	0.07160	589	0.06650	634	0.11220	679	0.01110	724	0.00260	769	0.00070
410	0.00070	455	0.12370	500	0.05440	545	0.07180	590	0.06610	635	0.13690	680	0.01070	725	0.00260	770	0.00070
411	0.00080	456	0.11470	501	0.05550	546	0.07190	591	0.06570	636	0.09600	681	0.01040	726	0.00250	771	0.00060
412	0.00080	457	0.10560	502	0.05670	547	0.07190	592	0.06530	637	0.06010	682	0.01010	727	0.00240	772	0.00060
413	0.00100	458	0.09710	503	0.05770	548	0.07200	593	0.06480	638	0.04420	683	0.00980	728	0.00240	773	0.00060
414	0.00120	459	0.08950	504	0.05860	549	0.07200	594	0.06440	639	0.03820	684	0.00950	729	0.00230	774	0.00060
415	0.00140	460	0.08420	505	0.05950	550	0.07180	595	0.06390	640	0.03550	685	0.00920	730	0.00220	775	0.00060
416	0.00160	461	0.07880	506	0.06040	551	0.07200	596	0.06370	641	0.03400	686	0.00890	731	0.00220	776	0.00060
417	0.00190	462	0.07570	507	0.06130	552	0.07190	597	0.06470	642	0.03280	687	0.00860	732	0.00210	777	0.00050
418	0.00220	463	0.07310	508	0.06180	553	0.07210	598	0.06450	643	0.03210	688	0.00830	733	0.00200	778	0.00050
419	0.00250	464	0.07040	509	0.06260	554	0.07200	599	0.06330	644	0.03160	689	0.00810	734	0.00200	779	0.00060
420	0.00290	465	0.06810	510	0.06310	555	0.07200	600	0.06260	645	0.03180	690	0.00790	735	0.00190	780	0.00050
421	0.00340	466	0.06550	511	0.06380	556	0.07210	601	0.06210	646	0.04020	691	0.00770	736	0.00180		
422	0.00390	467	0.06290	512	0.06450	557	0.07200	602	0.06160	647	0.05460	692	0.00750	737	0.00180		
423	0.00450	468	0.05980	513	0.06510	558	0.07210	603	0.06170	648	0.04800	693	0.00720	738	0.00170		
424	0.00520	469	0.05700	514	0.06550	559	0.07210	604	0.06130	649	0.03630	694	0.00700	739	0.00160		

### UNIFIED GLARE RATING

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size	UGR Viewed Crosswise					UGR Viewed Endwise					
X=2H	Y=2H	16.6	17.6	17.5	18.5	19.6	16.4	17.4	17.3	18.3	19.4
	3H	18.3	19.2	19.2	20.1	21.2	18.1	19.0	19.0	19.9	21.0
	4H	18.9	19.8	19.8	20.7	21.8	18.7	19.6	19.6	20.4	21.6
	6H	19.3	20.1	20.2	21.0	22.1	19.1	19.9	20.0	20.8	21.9
	8H	19.4	20.2	20.3	21.1	22.2	19.2	20.0	20.1	20.9	22.0
	12H	19.5	20.2	20.4	21.1	22.3	19.3	20.0	20.2	20.9	22.1
4H	2H	17.1	18.0	18.0	18.9	20.0	17.0	17.8	17.9	18.7	19.8
	3H	19.1	19.8	20.0	20.7	21.8	18.9	19.6	19.8	20.5	21.7
	4H	19.8	20.5	20.7	21.4	22.5	19.6	20.3	20.5	21.2	22.3
	6H	20.3	20.9	21.3	21.8	23.0	20.2	20.7	21.1	21.7	22.8
	8H	20.5	21.0	21.4	21.9	23.1	20.3	20.9	21.3	21.8	23.0
	12H	20.6	21.0	21.5	22.0	23.2	20.4	20.9	21.4	21.8	23.0
8H	4H	20.0	20.6	21.0	21.5	22.7	19.9	20.4	20.8	21.3	22.5
	6H	20.7	21.1	21.6	22.1	23.3	20.6	21.0	21.5	22.0	23.1
	8H	20.9	21.3	21.9	22.2	23.4	20.8	21.2	21.8	22.1	23.3
	12H	21.0	21.4	22.0	22.3	23.6	20.9	21.3	21.9	22.2	23.5
12H	4H	20.0	20.5	21.0	21.5	22.6	19.9	20.3	20.8	21.3	22.5
	6H	20.7	21.1	21.7	22.1	23.3	20.6	21.0	21.6	21.9	23.2
	8H	21.0	21.3	21.9	22.3	23.5	20.9	21.2	21.8	22.2	23.4

The UGR values have been calculated according to CIE Publ. 117.

Spacing-to-Height-Ratio = 1.00.

The highlighted value refers to the UGR value which the luminaire would have in a reference situation with room dimensions of 4H/8H and degrees of reflectance of 20% for the floor, 50% for the walls and 70% for the ceiling, as recommended by DLC.

The UGR value may vary depending on application specific parameters.